


## REMEMBER ... CALL 811 BEFORE YOU DIG!

1. Customer's equipment must be approved by a State of Oregon certified electrical inspector.
2. A building permit is required and an electrical inspection must be passed prior to connection.
3. Service will not be energized until installation meets all EPUD specifications.

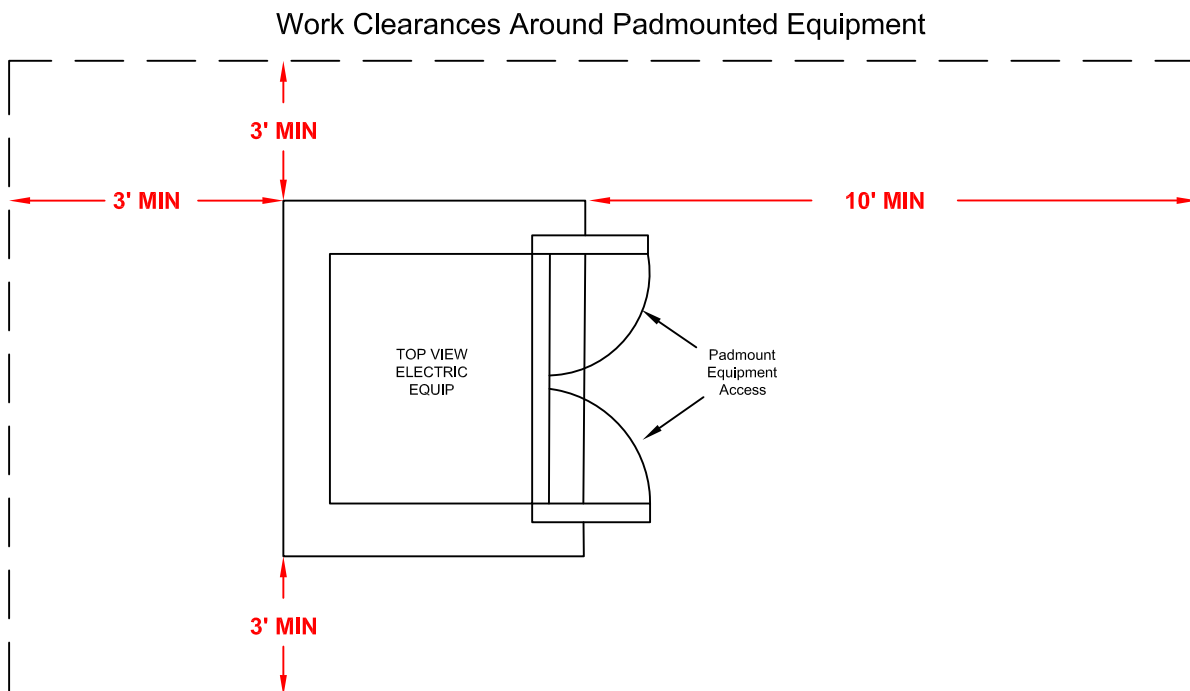

1. A minimum clearance of 10 feet of clear, level working space is required in front of a padmount transformer to allow use of hot sticks.
2. Other clearances are shown and all apply to padmounted equipment.
3. Landscaping and other obstructions must not encroach on these clearances.
4. Any landscaping or obstructions which encroach upon Emerald People's Utility District's easement shall be relocated or removed at property owner's expense.