


REMEMBER ... CALL 811 BEFORE YOU DIG!

1. Customer's equipment must be approved by a State of Oregon certified electrical inspector.
2. A building permit is required and an electrical inspection must be passed prior to connection.
3. Service will not be energized until installation meets all EPUD specifications.

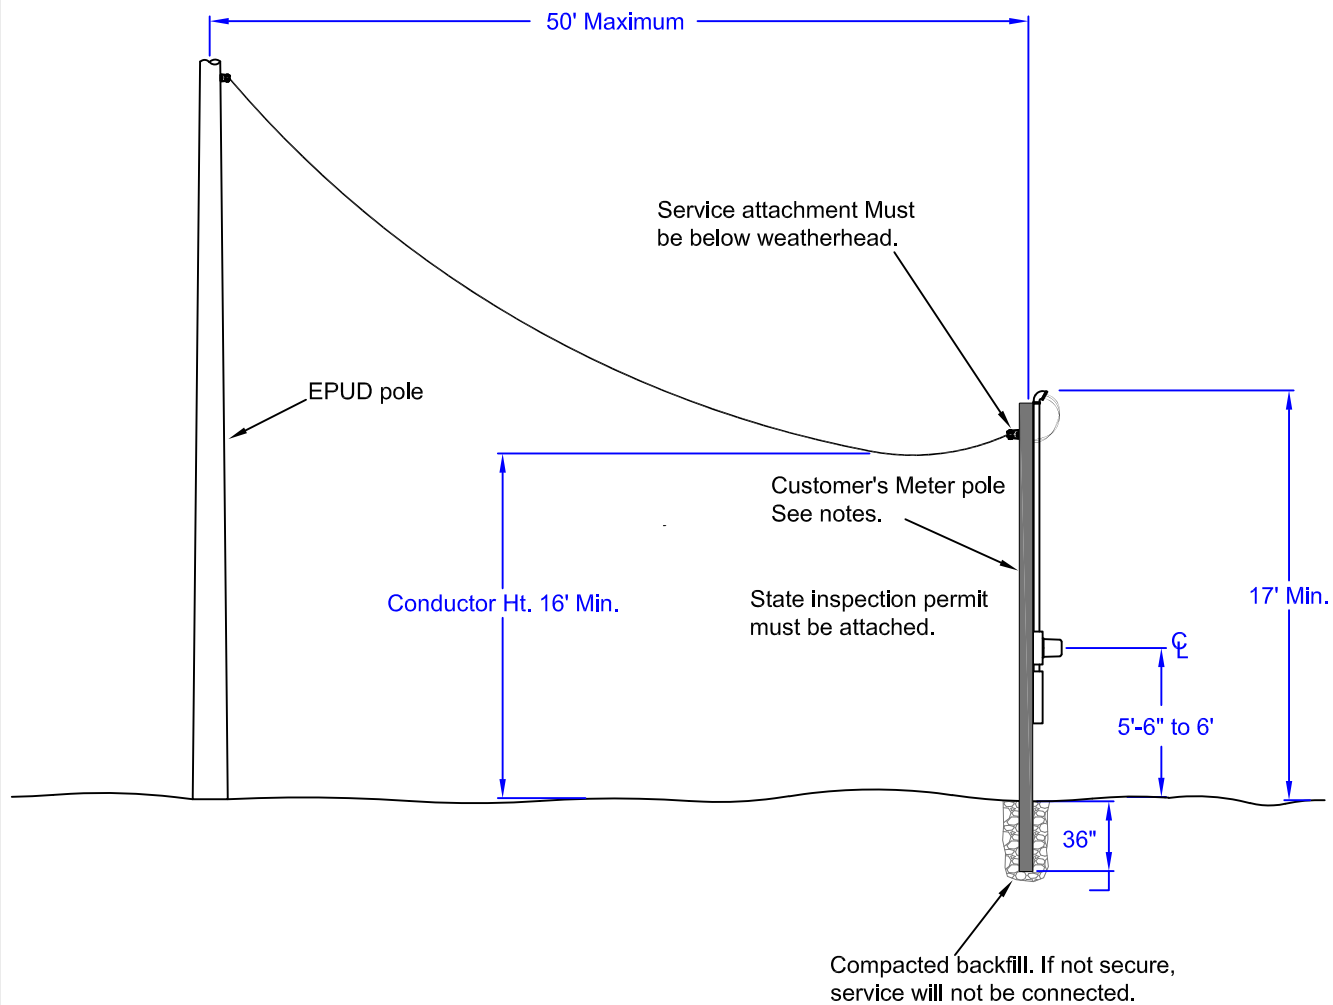

NOTE:

1. Customer's meter pole must be a minimum 6" x 6" pressure treated lumber.
2. Customer owns the meter pole and is responsible for maintaining the pole such that it is structurally sound and provides an adequate support for the EPUD point of attachment.

Overhead Service to Customer's Meter Pole